
3

,

16

2

3

4

5

6

7

1

2

3

4

1

2

3

4

7

8

6

1

2

3

4

1

2

1


2

3

4

5

J

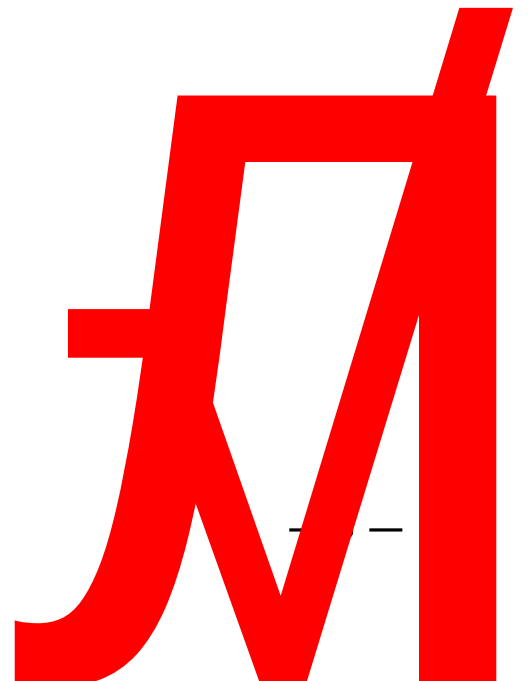

1

2

3

4

1

2

3

4

5

1

2

1

2

3

1

2

3

4

3 16

8-1 13-1

12-4 7-1 8-4
3605 3607 3608 3609
 12-4 8-4 3608

12-4 13-1 3605

1

2

3

4

5

1

2

3

4

1

2

3

4

3

5

6

7

8

9

10

11

6

1

2

3

4

1

2

3

1

2

1

2

3

4

5

6

7

1

2

3

4

5

6

1

2

1

2

3

1

2

3

4

3 16

1

2

3

4

5

1

2

3

1

2

3

4

5

6

7

8

9

10

11

1

2

3

5.0%

4

12

1

2

3

4

2.0%

5

6

7

50m

10

11

12

13

13

,

,

1

2

3

4

1

2

3

1

2

1

2

3

4

5

6

7

1

2

3

4

5

6

1

2

3

4

1

2

3

4

5

18.5% 22% 24ppm
1%

1

2

3

1

2

3

4

$0.50\text{m}^3/\text{t}$

$0.78\text{m}^3/\text{min}$

1

2

1

5

6

7

8

9

10

1

5

1

3.0%

(2)

1

3.0%

3.2.3

(1)

(2)

(3)

1

1.5

(4)

1

2

3

4

1

2

3

1

2

1

2

3

4

5

6

7

1

1

2

3

4

5

18.5% 22% 24ppm
1%

1

2

3

1

2

3

3 16

33.54% 43.74%

1

2

3

4

5

1

2

3

1

2

3

4

5

6

7

%

6

1

2

3

4

1

2

7

1

2

3

4

5

1

2

3

4

1

2

3

4

5

18.5% 22% 24ppm
1%

1

2

3

1

2

3

4

2

3

4

5

1

2

3

2

1

2

1

2

1

2

3

1

2

1

2

3

4

5

6

1

2

1

2

3

1

2

3

1

2

3

4

1

2

3

4

5

1

2

3

1

2

3

1

2

20%

20%

3

4

1

2

1

2

3

1

2

4

5

6

7

1

2

3

1

2

1

2

3

4

5

6

1

2 ()

3

4

1

2

3

4

5

1

2

3

1

2

3

1

2

3

4

35kv

1

2

3


4

5

1

2

3

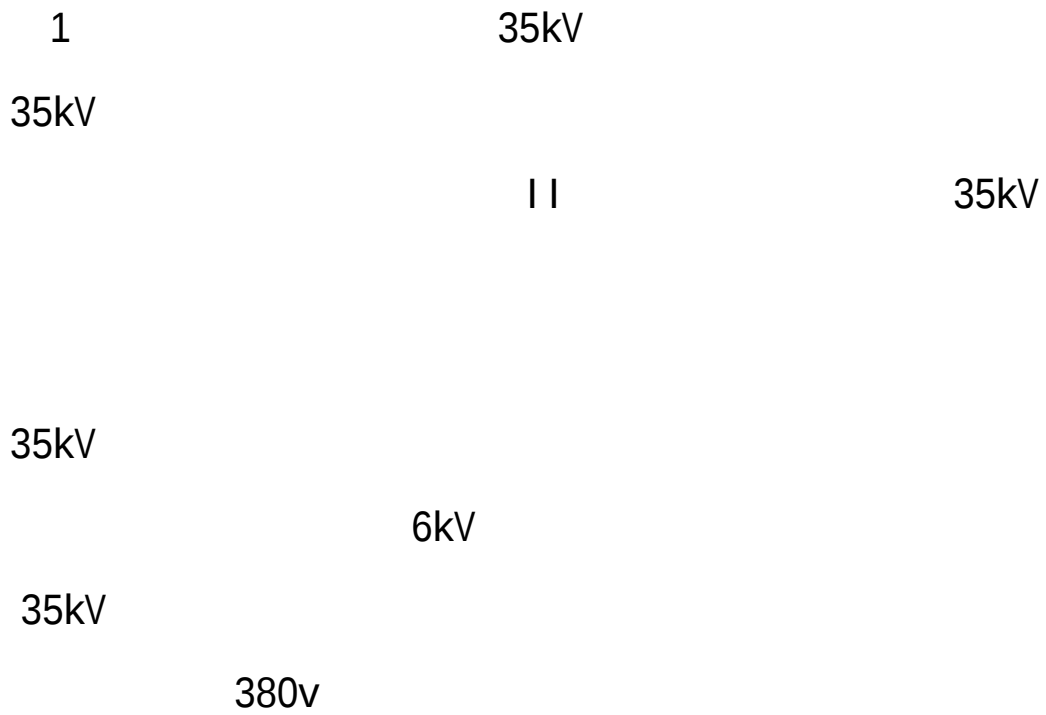



— 77 —

1 35kV

2 35kV 35KV

I 35KV I 1#

3 6KV I

KV I

4 35KV

5# 6kv I 5# 6kv I 19# 1

6kv I 7# I

380vI 7# I 380vI 3#

∂°2 B∂

U² >
%


35KV

W ..


e


4Q e ©

#

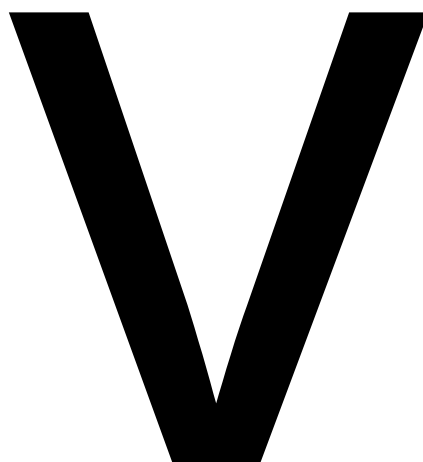

de C 2 BCD8!0U!@
7Q30, e

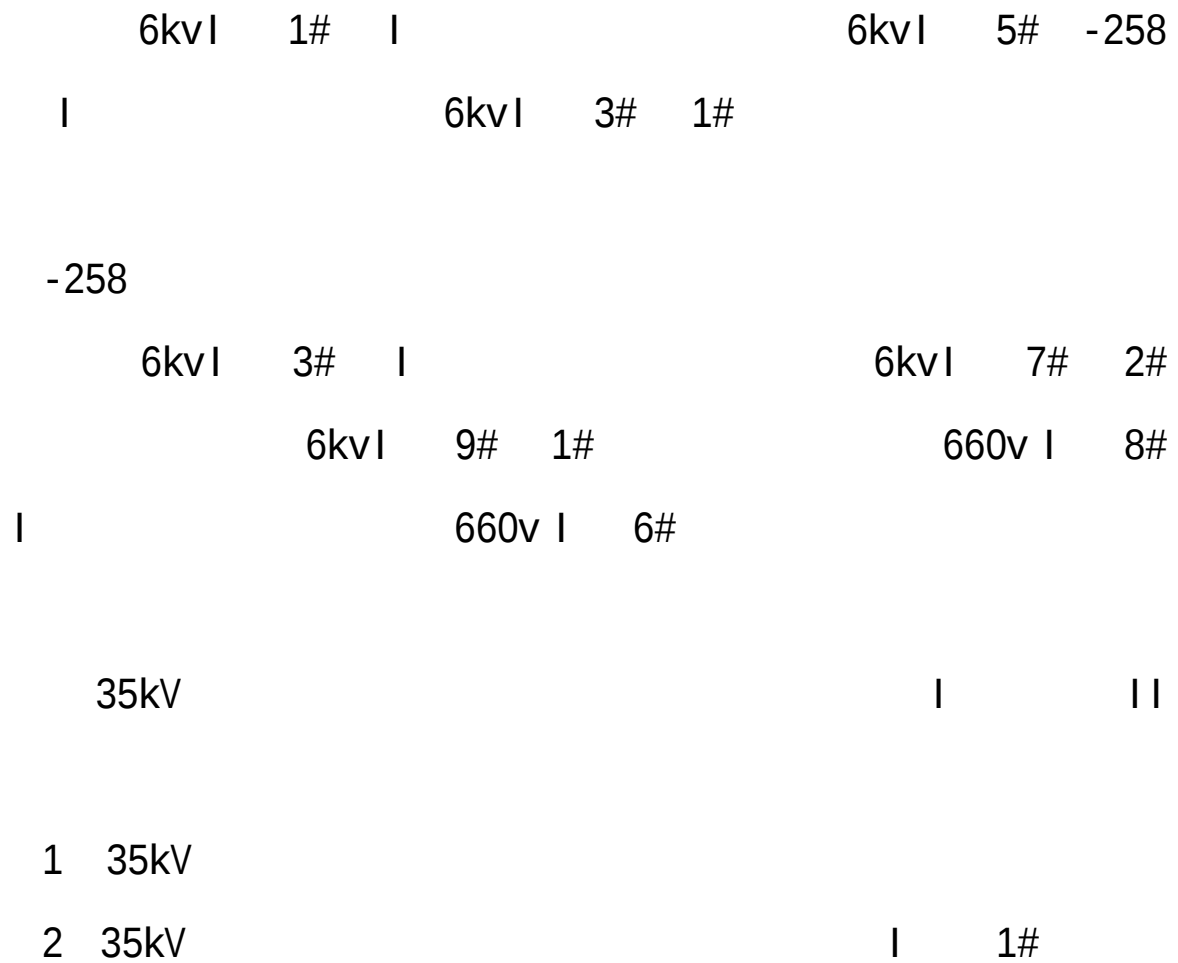

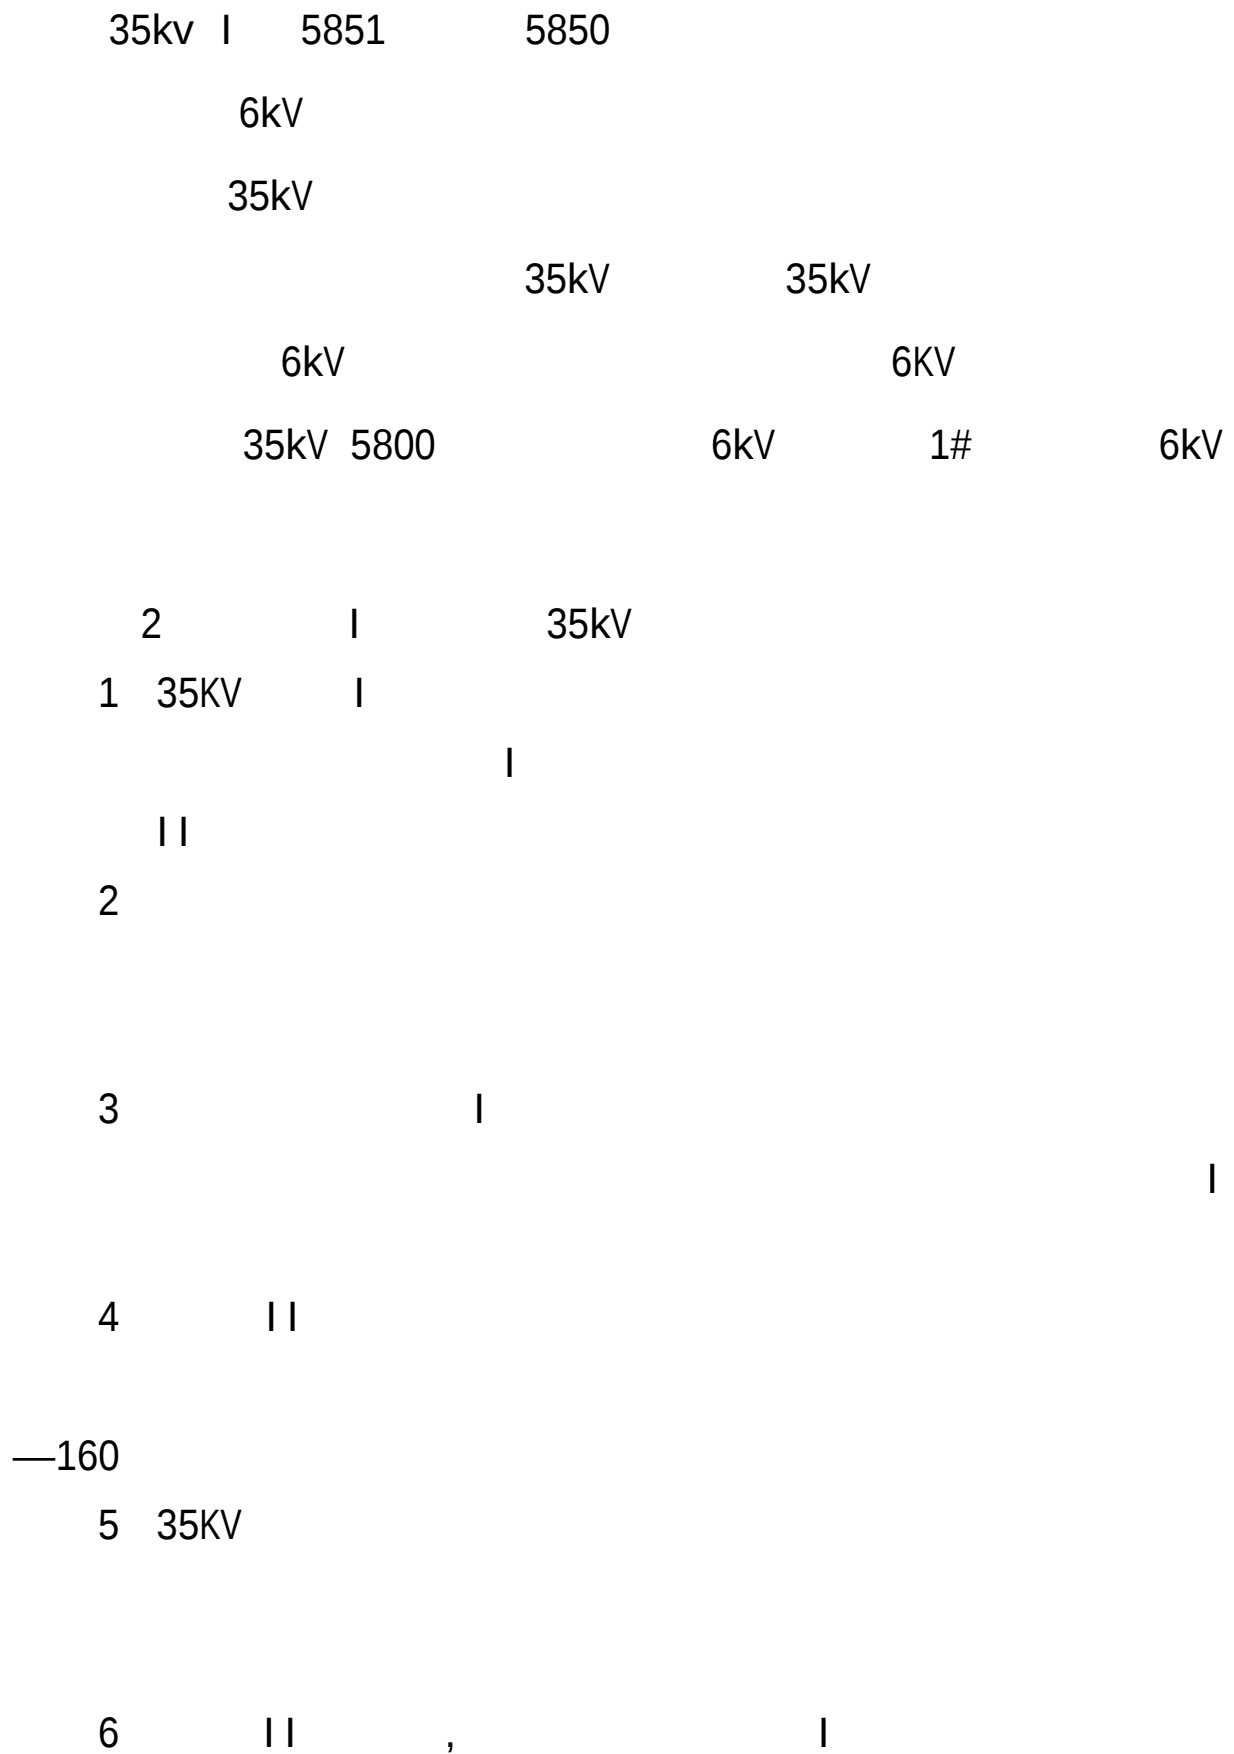


7

8 35KV

1

9

,

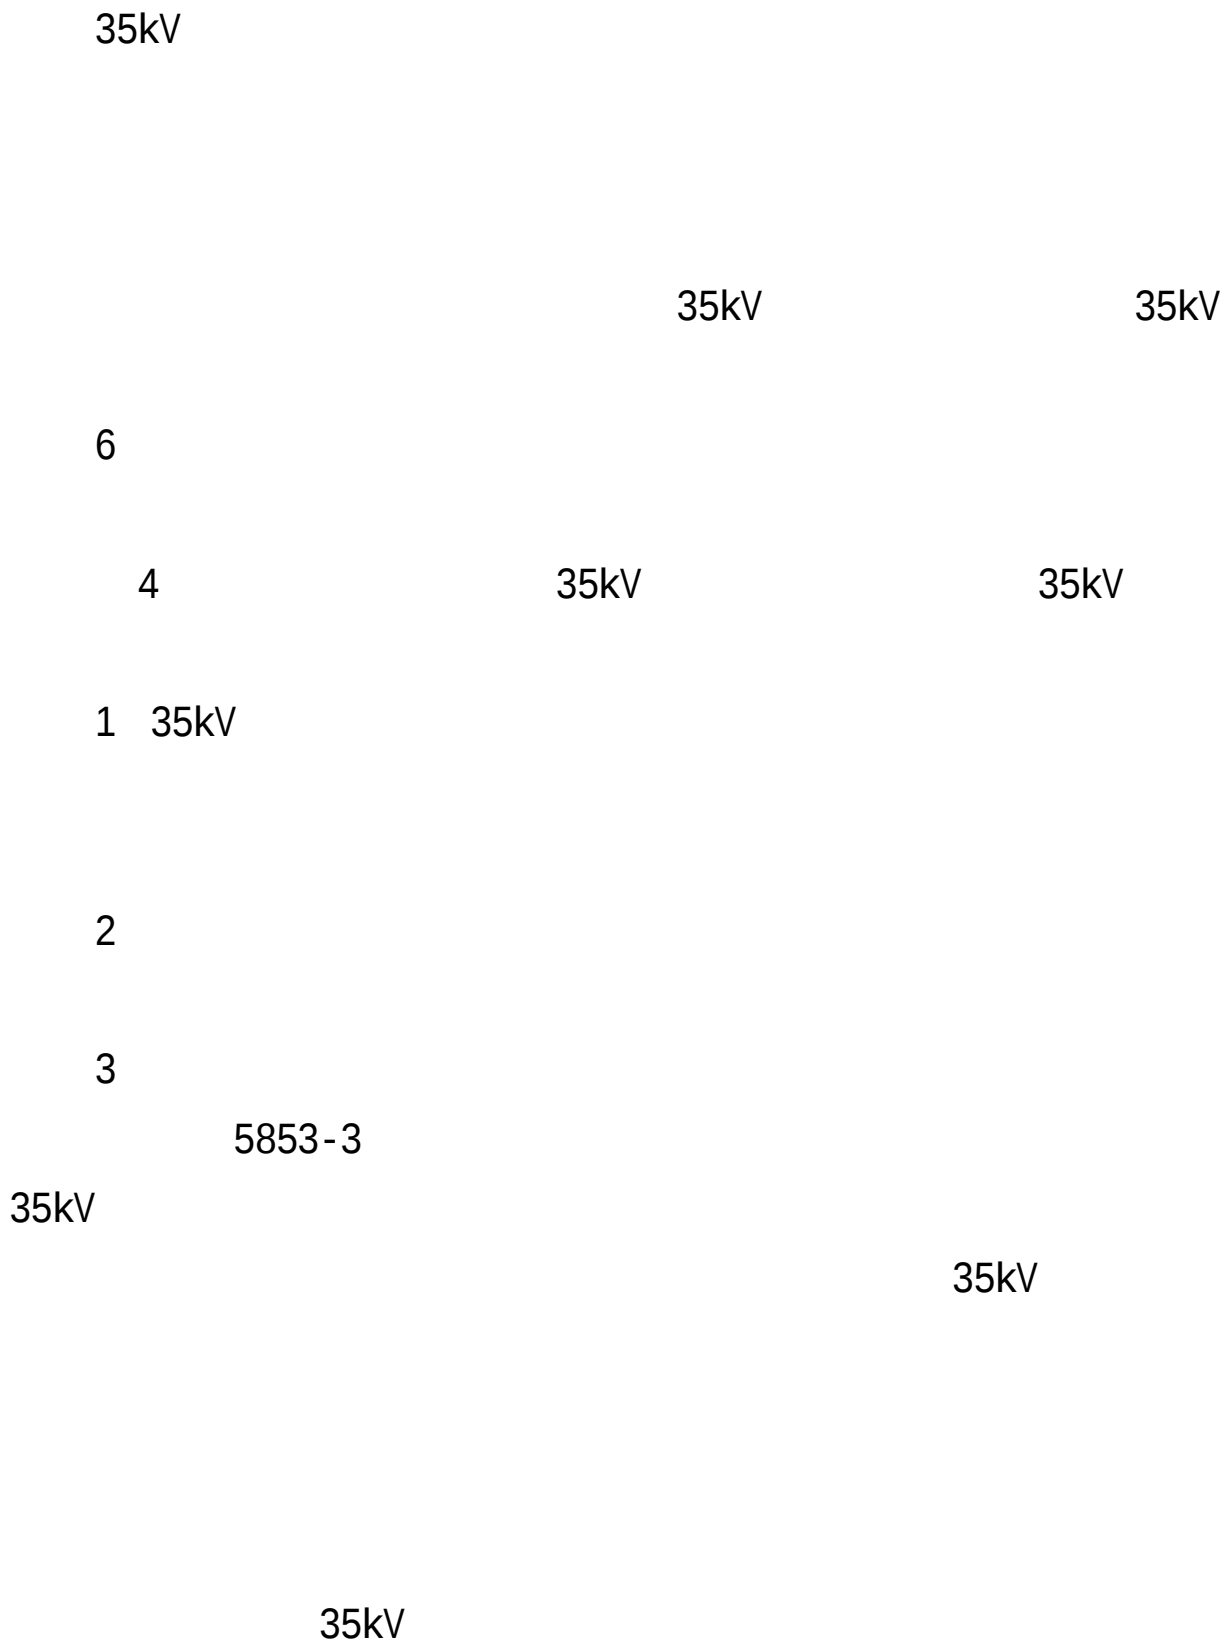



35kV I

I 1#

1

2

3

4

5

1

2

3

4 35kV

1

2

3

35kV

0.6m

4

6

1

2

3

1

2

1

2

3

4

5

6

1

2

3

4

5

6

7

8

9

10

11

1

2

1

2

3

1

2

3

4

2

3

4

5

1

2

3

1

2

3

“

”

4

5

6

1

2

3

4

1

2

3

1

2

1

2

3

4

5

6

7

1

2

3

4

5

1

2

1

2

3

4

5

18.5% 22% 24ppm
1%

1

2

3

1

2

3

4

35kV

1

2

3

4

5

1

2

3

4

1

2

3

,

4

5

6

7

8

9

10

11

6

1

2

3

1

2

3

4

5

6

7

1

2

3

4

5

6

1

2

1

2

3

1

2

3

4

35kV

- (1) 24 50mm
- (2)
- (3)
- ;
- (4)

(5)

(6) 10

(7)

1

2

3

4

5

(1) ()
)

(2)

(3)

(4)

(1)

()

(2)

()

(3)

(4)

(5)

(6)

(1) 24

(2)

60

(

)

()

“ ”

(7)

(8)

(1)

(2)

(3)

(4)

(5)

1

2

3

4

(5)

(6)

(7)

Ě

；

；

；

(1)

(2)

(3)

(4)

(5)

(6)

(7)

(1)

(2)

(1)

(2)

(3)

(1)

(2)

(3)

(4)

1

2

3

4

5

1

2

3

4

1

2

3

4

5

1

2


10

1

2



q · p

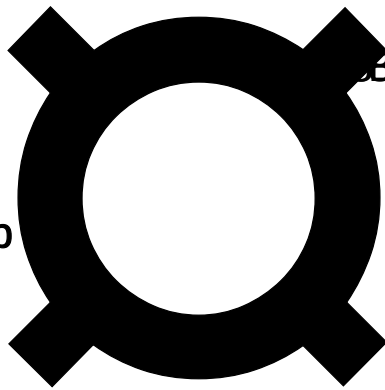

39 < € ¥

10min

2

()

30

3

4

5

6

8

				0.5
0.5	CO ₂	1.5		18
7		24		
			1% CO ₂	1.5%

1

2

3

1

,

2

3

4

5

6

7

1

2

3

4

5

6

7

1

2

1

2

3

1

2

3

4